



GANGED

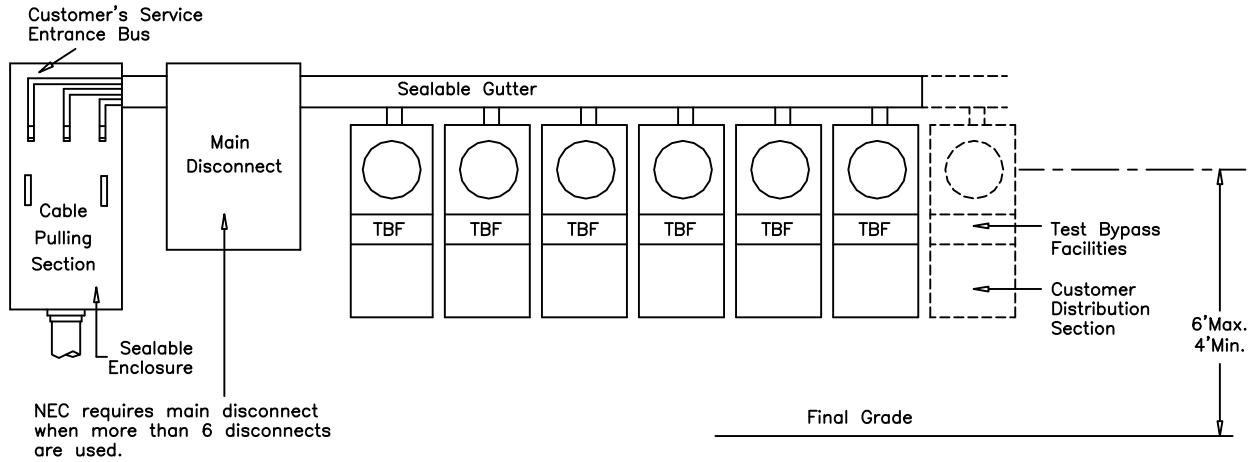

MODULE

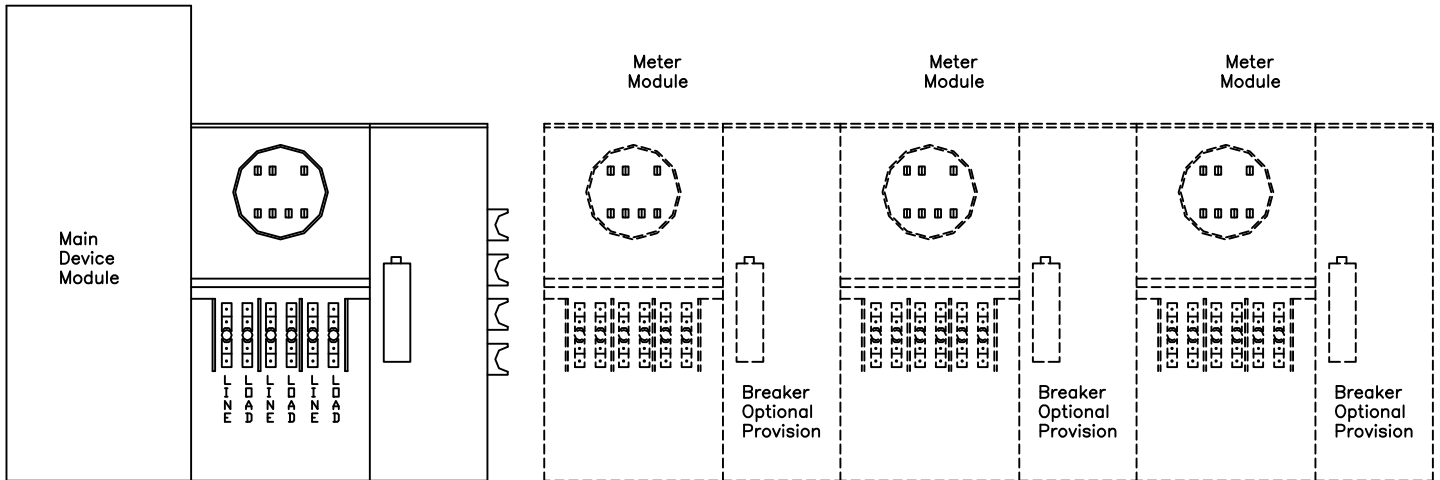

NOTES:

1. Cable pulling section must be sized for McMinnville Water & Light service termination (EUSERC 343) or, must have bus extension drilled for landing lugs. *The sum of distribution section ampacities must not exceed the pulling section ampacities.*
2. Each metered service must have a permanently engraved metal or hard plastic label to identify the Customer's address.



COMMERCIAL GANGED/MODULE METER SOCKET INSTALLATION

DATE	REVISION			DRAWING NO.
		DATE	2/10/99	
		DRAWN	JDW	APPROVED DJE
				SPEC NO. H26-A