



Busses shall be properly supported



(A) 100, 200 amp maximum single phase underground service combination meter socket. (EUSERC 301)

AMPS	N	X	Y
100	6"	8"	4"
200	8 1/2"	11"	5 1/2"

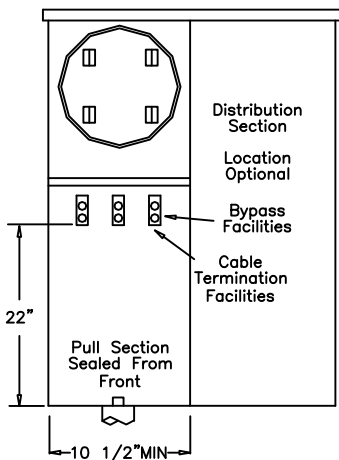

Busses shall be properly supported

(B) 400 amps maximum (320 amp continuous) single phase underground service combination meter socket. (EUSERC 302 shown, EUSERC 302A acceptable)

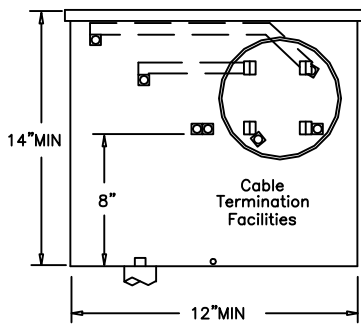

Busses shall be properly supported

(C) 200 amp maximum single phase underground service meter socket.

NOTE: Hubs are not approved for use on the concentric knock-out of underground socket enclosures. Approved bushings, box adapters, or other conductor protection are required for these enclosures.



RESIDENTIAL UNDERGROUND METER SOCKET INSTALLATION

DATE	REVISION

DATE	2/10/99	DRAWING NO.
DRAWN	JDW	APPROVED DJE
		SPEC NO. H4