



A V B... ATMOSPHERIC VACUUM BREAKER

- One AVB req'd for each irrigation zone, no control valves (on/off valves) allowed downstream of (after) an AVB.
- Each AVB must be installed a min. of six inches (6") above the highest point of water in the zone it serves.
- No chemical or fertilizer may be introduced into an irrigation system equipped with AVB's.
- No pumps or back pressure on downstream side of (after) an AVB.

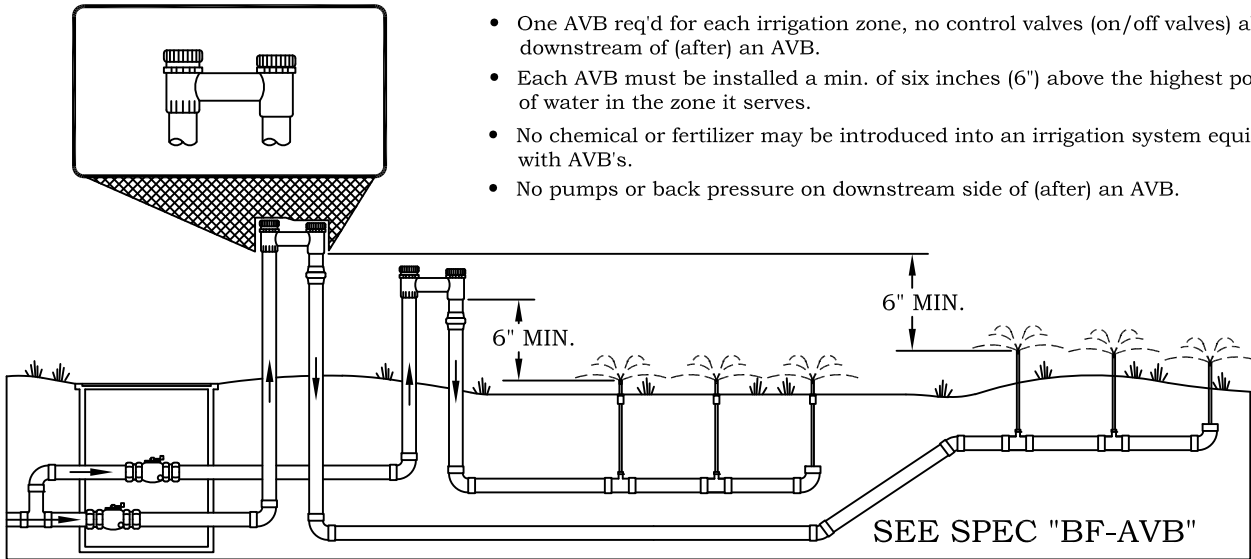


P V B... PRESSURE VACUUM BREAKER ASSEMBLY

- Only one PVB required to serve the whole system; control valves can be located downstream of (after) the PVB.
- PVB's must be installed a minimum of one foot (12") above the highest point of water they serve.
- PVB's must be tested by a State-certified Backflow Assembly Tester ...when installed ...annually ...when moved or repaired.
- No chemical or fertilizer may be introduced into an irrigation system equipped with PVB's.
- No pumps or back pressure on downstream side of (after) a PVB.

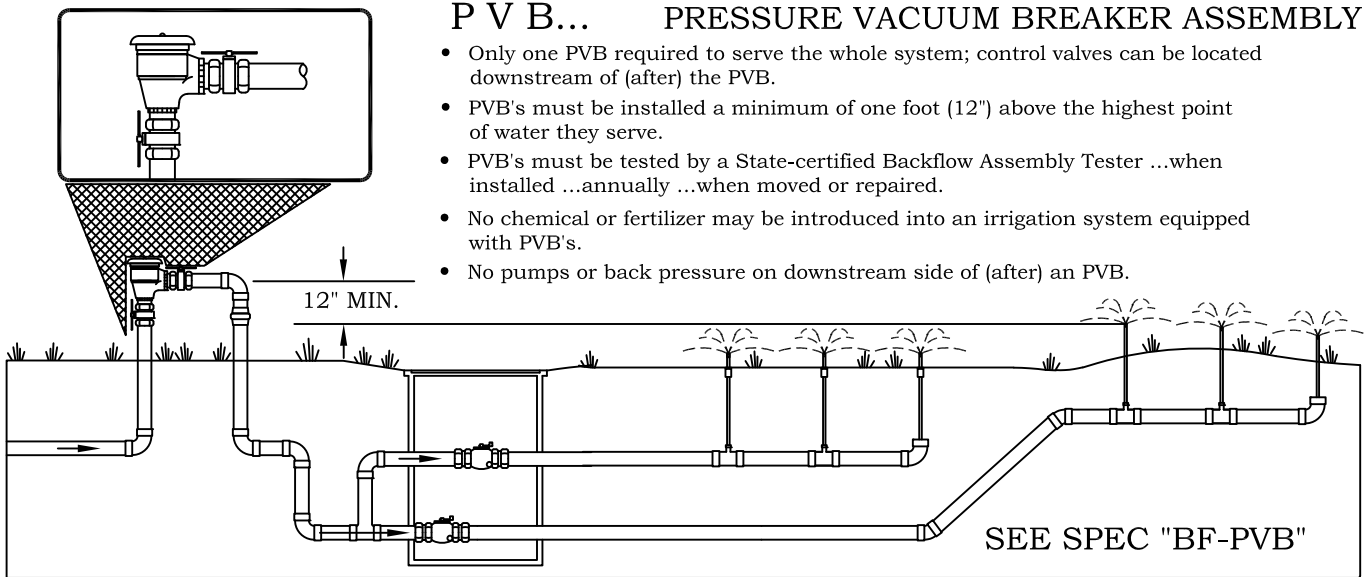

D C V A ... DOUBLE CHECK VALVE ASSEMBLY

- Only one DCVA required to serve the whole system; control valves can be located downstream of the DCVA.
- DCVA must be tested by a State-certified Backflow Assembly Tester ...when installed ...annually ...when moved or repaired.
- No chemical or fertilizer may be introduced into an irrigation system equipped with DCVA's.

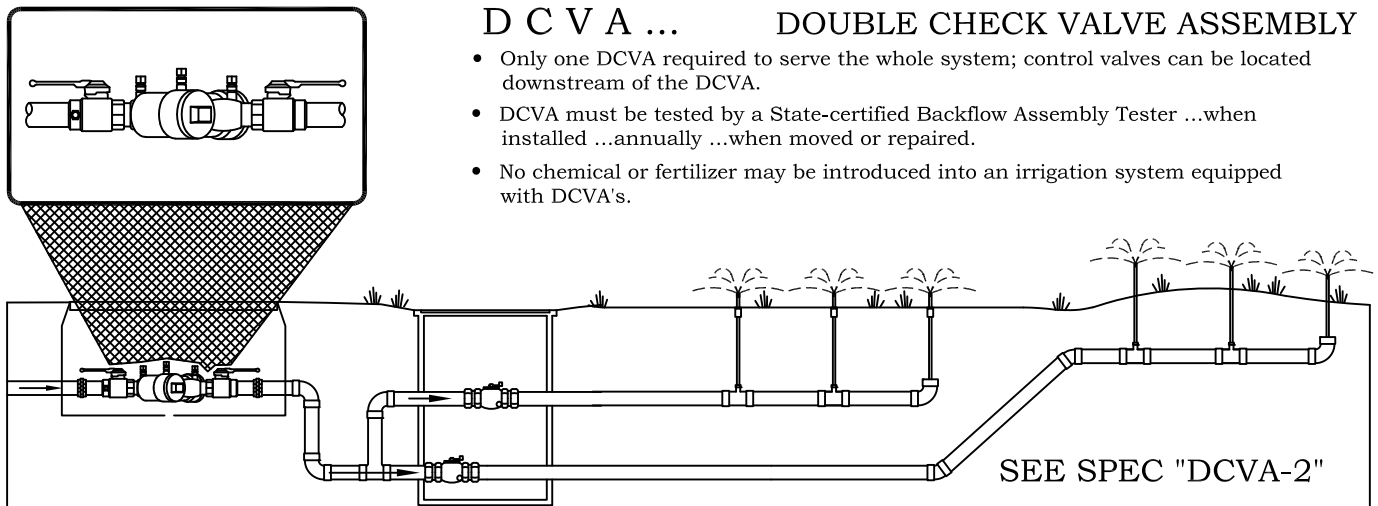

TYPICAL BACKFLOW PREVENTERS FOR LAWN SPRINKLER SYSTEMS

DATE	REVISION	DATE 12/8/14		
		DRAWN SLW	APPROVED WSC	SPEC NO. BF-LAWN