



PROVIDE BALL DRIP DRAIN VALVE TO DRAIN FDC, EITHER ON CHECK VALVE OR WITH HORIZONTAL TAPPING SADDLE

TOP VIEW

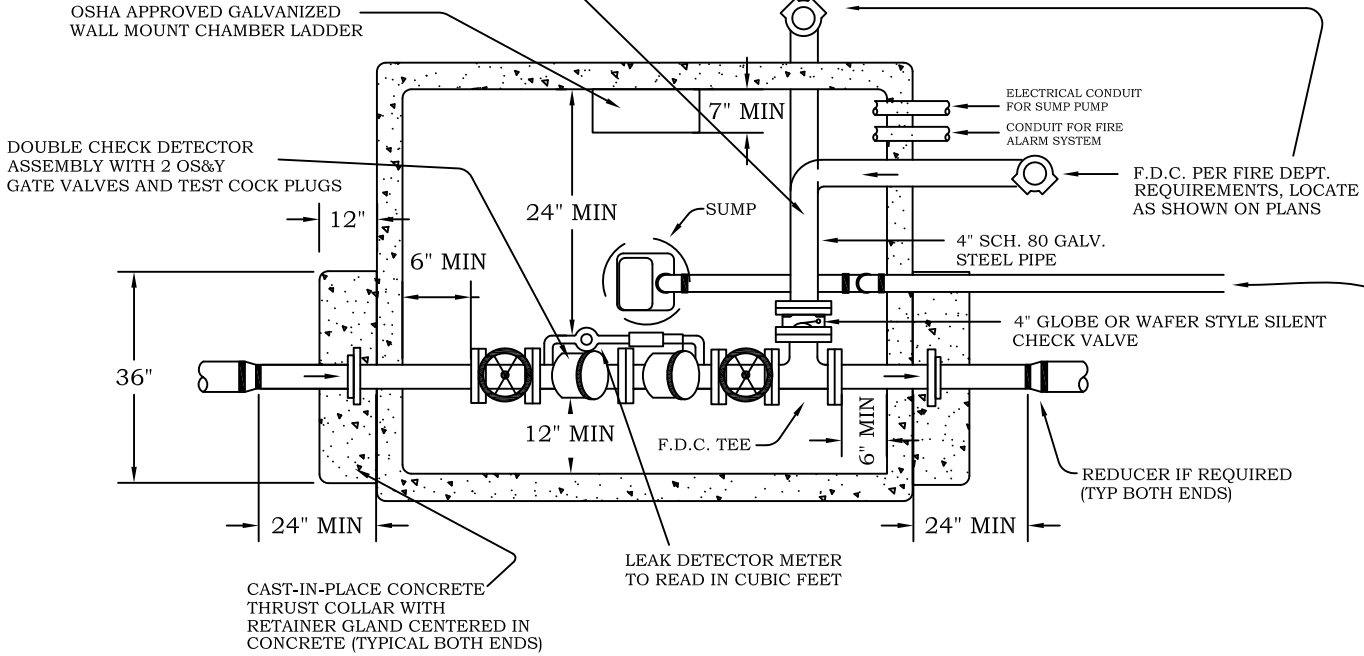

SIDE VIEW

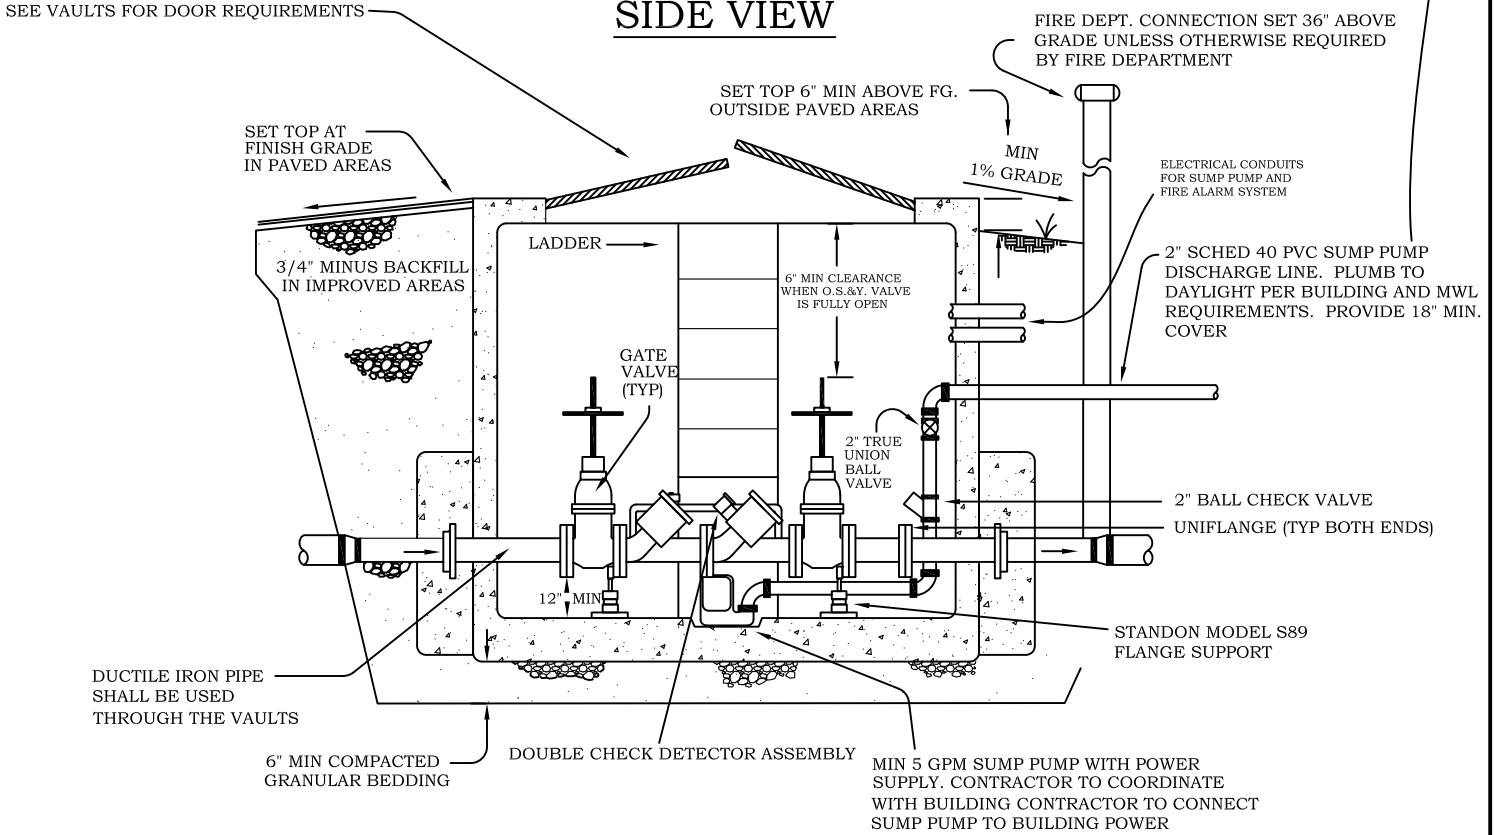

NOT TO SCALE



DOUBLE CHECK DETECTOR ASSEMBLY 2.5" AND LARGER WITH FDC

(REQUIRED ON FIRE SERVICE LINES)

DATE	REVISION		
		DATE	02/14/18
		SHEET NO.	1 OF 2
		DRAWN	SLW
		APPROVED	WSC
		SPEC NO.	DCDA-1