


FOR DESIGN ONLY

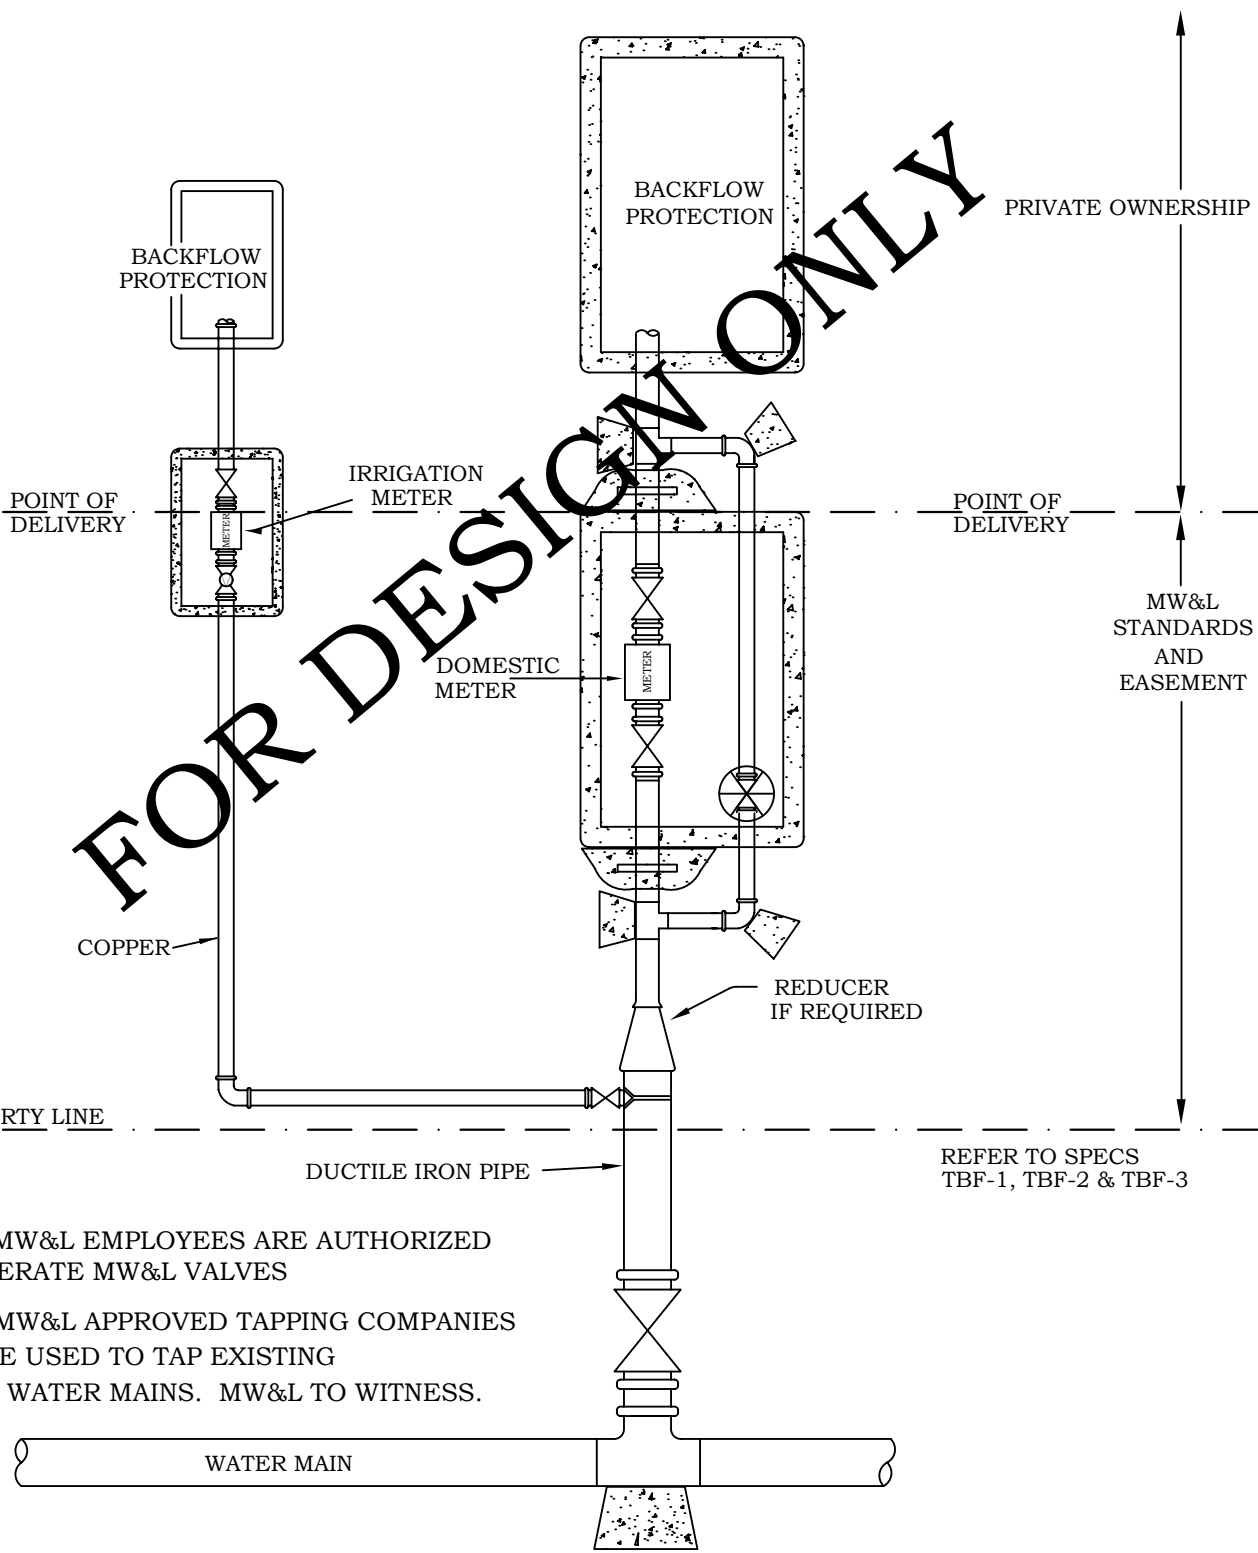

**NOTES:**

- 1) ONLY MW&L EMPLOYEES ARE AUTHORIZED TO OPERATE MW&L VALVES
- 2) ONLY MW&L APPROVED TAPPING COMPANIES MAY BE USED TO TAP EXISTING MW&L WATER MAINS. MW&L TO WITNESS.

REFER TO SPECS  
TBF-1, TBF-2 & TBF-3

NOT TO SCALE



## GENERAL SERVICE COMBINED IRRIGATION & DOMESTIC METER VAULT FOR DESIGN

DATE	REVISION			
		DATE 12/8/14		
		DRAWN SLW	APPROVED WSC	SPEC NO. GS-C