


FOR DESIGN ONLY

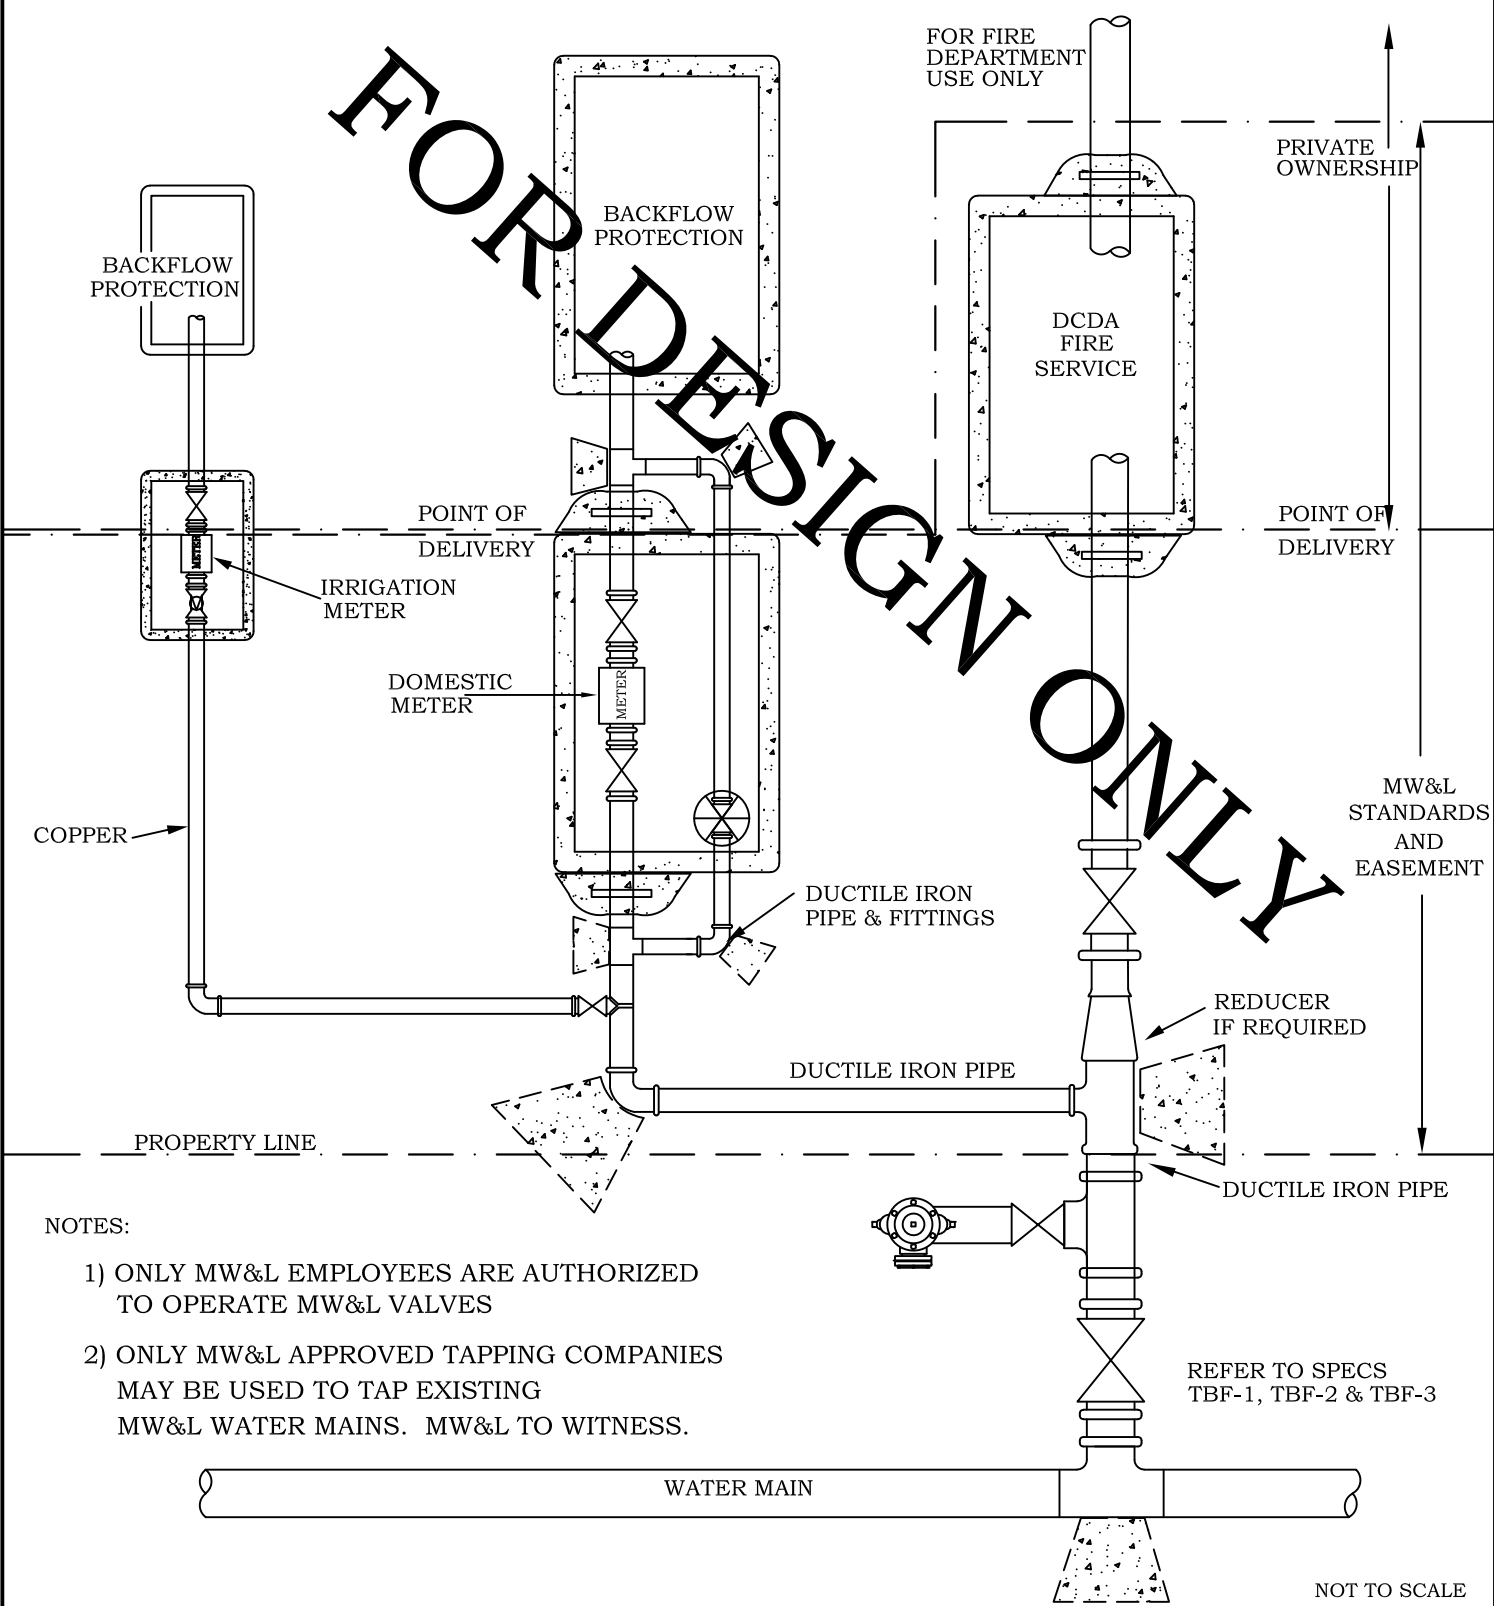

NOTES:

- 1) ONLY MW&L EMPLOYEES ARE AUTHORIZED TO OPERATE MW&L VALVES
- 2) ONLY MW&L APPROVED TAPPING COMPANIES MAY BE USED TO TAP EXISTING MW&L WATER MAINS. MW&L TO WITNESS.

REFER TO SPECS TBF-1, TBF-2 & TBF-3



**GENERAL SERVICE
SEPARATE FIRE & DOMESTIC
VAULT FOR DESIGN**

DATE	REVISION			
		DATE	12/8/14	
		DRAWN	SLW	APPROVED
			WSC	SPEC NO.
				GS-S