


TOP VIEW

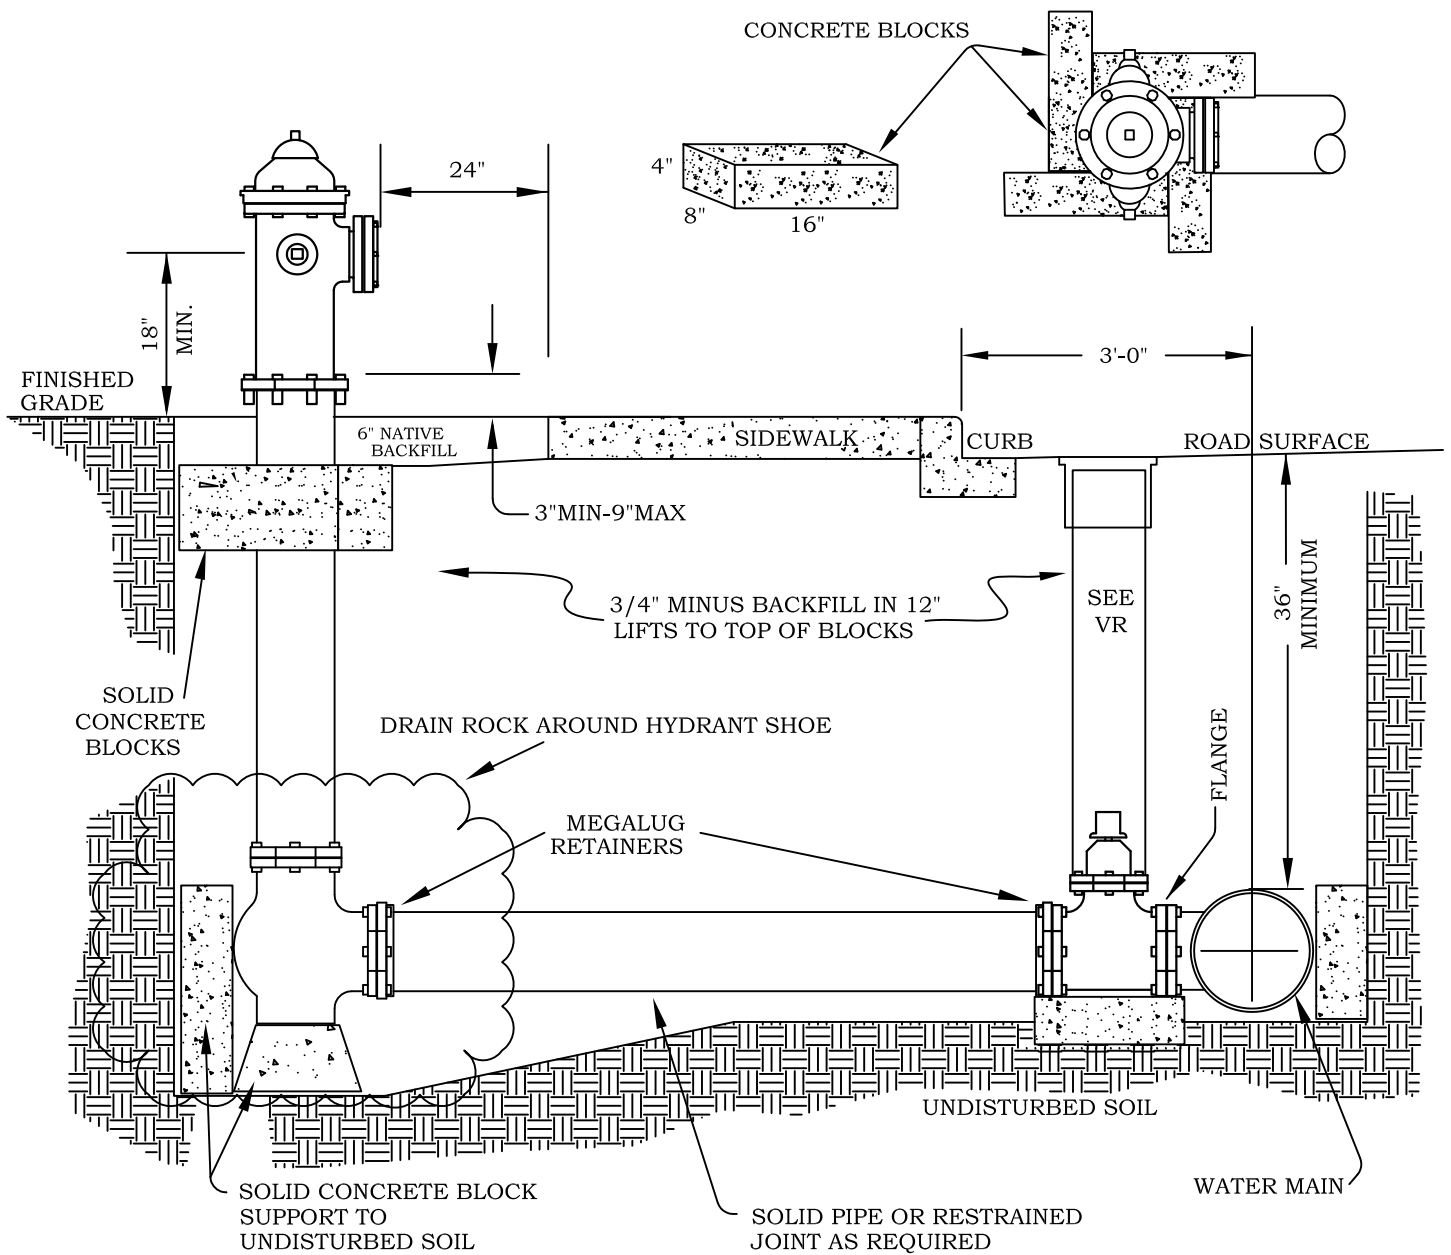

NOTES:

- 1) RESTRAIN ALL JOINTS FROM THE MAIN TO THE MECHANICAL SHOE OF THE HYDRANT USING MEGALUGS. (SEE MR)
- 2) STEAMER PORT SHALL BE FITTED WITH A 1/4 TURN 5" STORZ ADAPTER PER MCMINNVILLE FIRE DEPARTMENT REQUIREMENTS.
- 3) ALL BACKFILL MATERIAL WILL MEET OR EXCEED APPLICABLE STANDARDS FOR TYPE AND COMPACTION. SEE TRENCH BACKFILL DETAIL TBF-1 & TBF-2
- 4) DRAIN ROCK AROUND HYDRANT SHOE
- 5) 3/4-MINUS REQUIRED IN OVER EXCAVATION.
- 6) KEEP DRAIN HOLES FREE OF DEBRIS.
- 7) REFER TO THE APPROVED MATERIALS LIST FOR HYDRANT SPECIFICATIONS.

NOT TO SCALE



FIRE HYDRANT & VALVE INSTALLATION " CURB SIDE SIDEWALK "

DATE	REVISION		
		DATE	06/04/18
		DRAWN	SLW
		APPROVED	WSC
		SPEC NO.	FH-CSS