



TOP VIEW

PIPE SIZE	"A"
4"	12"
6"	12"
8"	18"
10"	24"

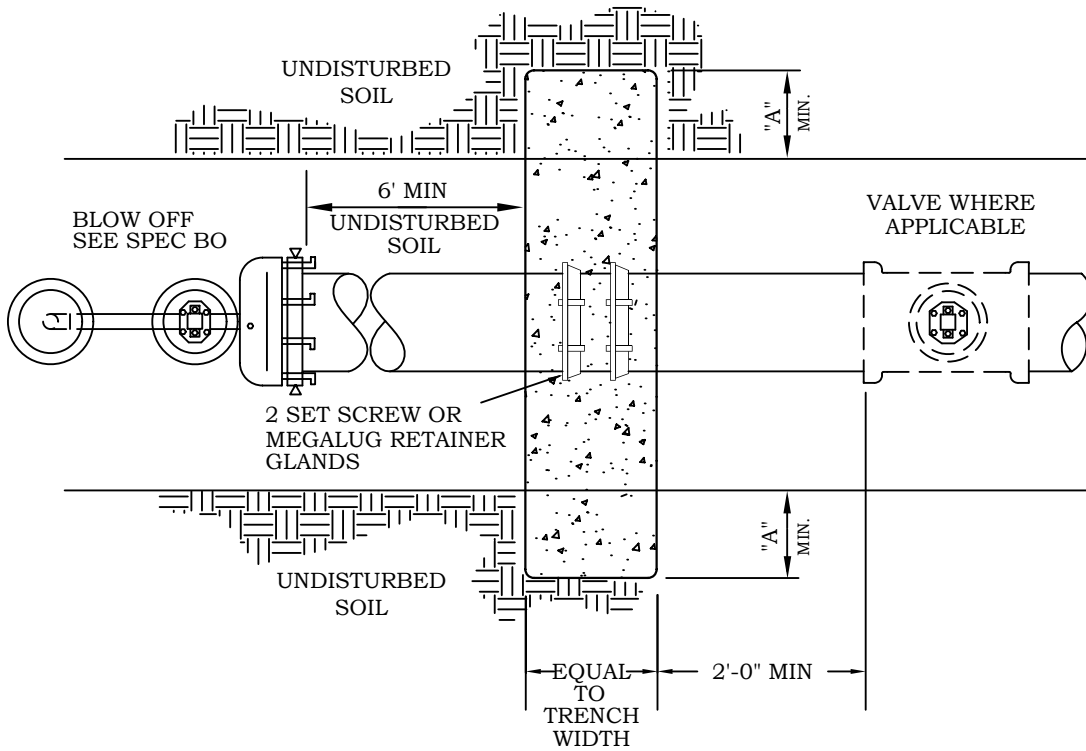

SIDE VIEW

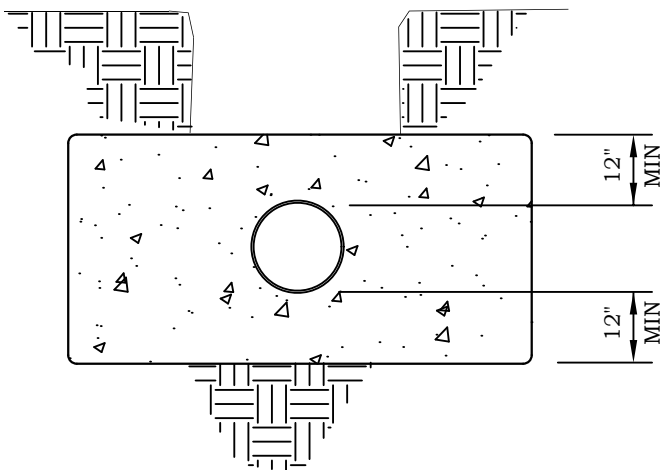


NOTES:

1. STRADDLE BLOCKS SHALL BE BASED ON THE FOLLOWING:
 - a.) 150 PSI WATER PRESSURE
 - b.) SOIL BEARING CAPACITY
2. BEARING AREA OF BLOCK SHALL BE AGAINST UNDISTURBED SOIL.
3. STRADDLE BLOCK SHALL HAVE A MINIMUM OF 18" COVER.
4. CONCRETE SHALL HAVE A MIN. 28 DAY STRENGTH OF 3000 PSI.
5. 2-SET SCREW OR MEGALUG RETAINER GLANDS ENCASED IN CONCRETE STRADDLE BLOCK.
6. PLACE STRADDLE BLOCK IN UNDISTURBED NATIVE SOIL.

NOT TO SCALE



STRADDLE BLOCK FOR 4" TO 10" PIPE

		<h2 style="margin: 0;">STRADDLE BLOCK FOR 4" TO 10" PIPE</h2>		
DATE	REVISION			
		DATE	12/8/14	
		DRAWN	SLW	APPROVED WSC
				SPEC NO. SB-1