



TOP VIEW

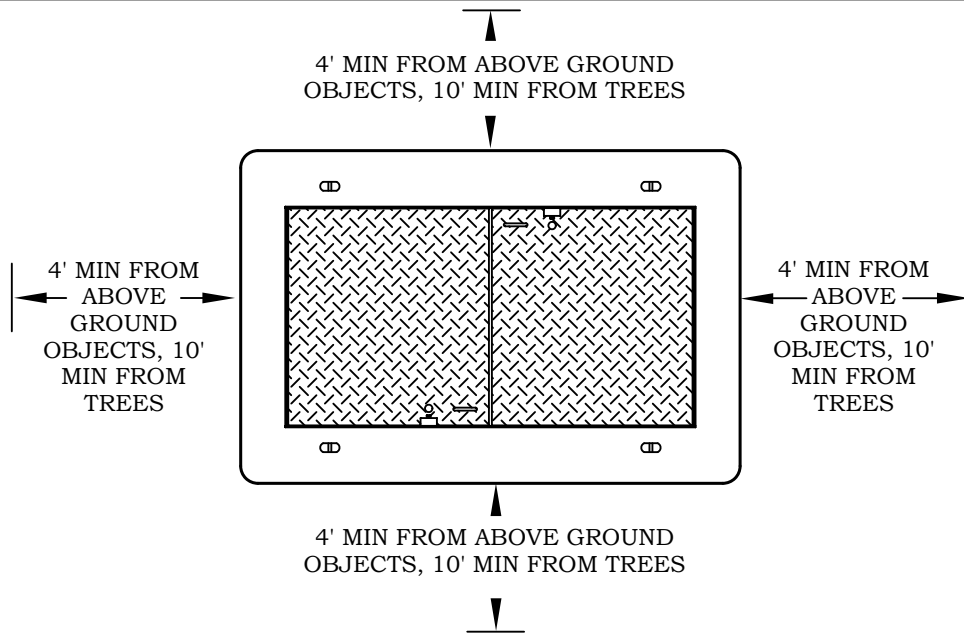

SIDE VIEW

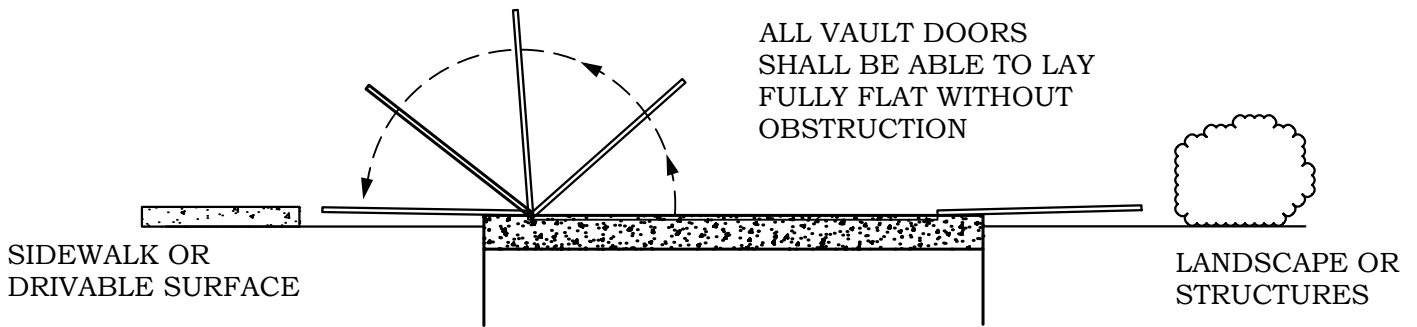

NOTES:

- 1) WHEN VAULT DOORS ARE OPEN THEY MUST LAY FLAT. THEY MUST NOT BE IN A WALKABLE OR DRIVEABLE SURFACE.
- 2) MAINTAIN A MINIMUM 4' FROM VAULT EDGE TO ANY ABOVE GROUND OBJECT.
- 3) 10' MIN FROM FACE OF TREES. TREES SHALL BE PLANTED FAR ENOUGH FROM VAULTS THAT UPON MATURITY, OVERHANGING BRANCHES WILL NOT OBSTRUCT A CRANE FROM SETTING OR REMOVING EQUIPMENT.

NOT TO SCALE



CLEARANCES FROM VAULTS

DATE	REVISION		
		DATE 12/9/14	
		DRAWN SLW	APPROVED WSC
			SPEC NO. VAULTCLEAR