

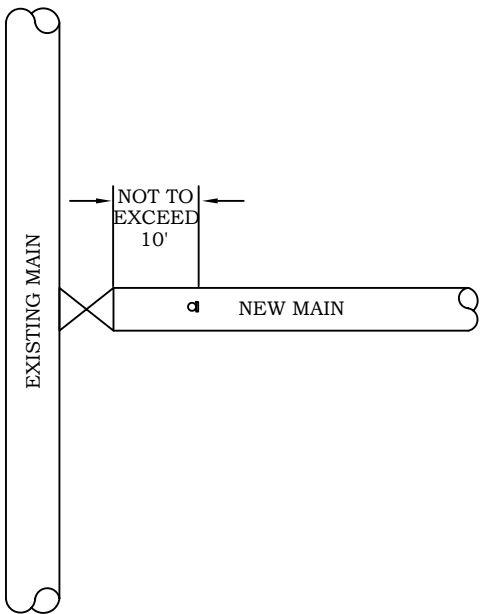


NOTE: PROVIDE HYDROSTATIC AND CHLORINATION TAP FOR TESTING AND DISINFECTION. REMOVE CORP AND PLUG WITH CC MUELLER TAPERED PLUG WHEN PROCESS COMPLETE, MW&L TO WITNESS.

ALL MATERIAL SHALL MEET NSF 61, ANNEX G, NSF 372 CERTIFICATION

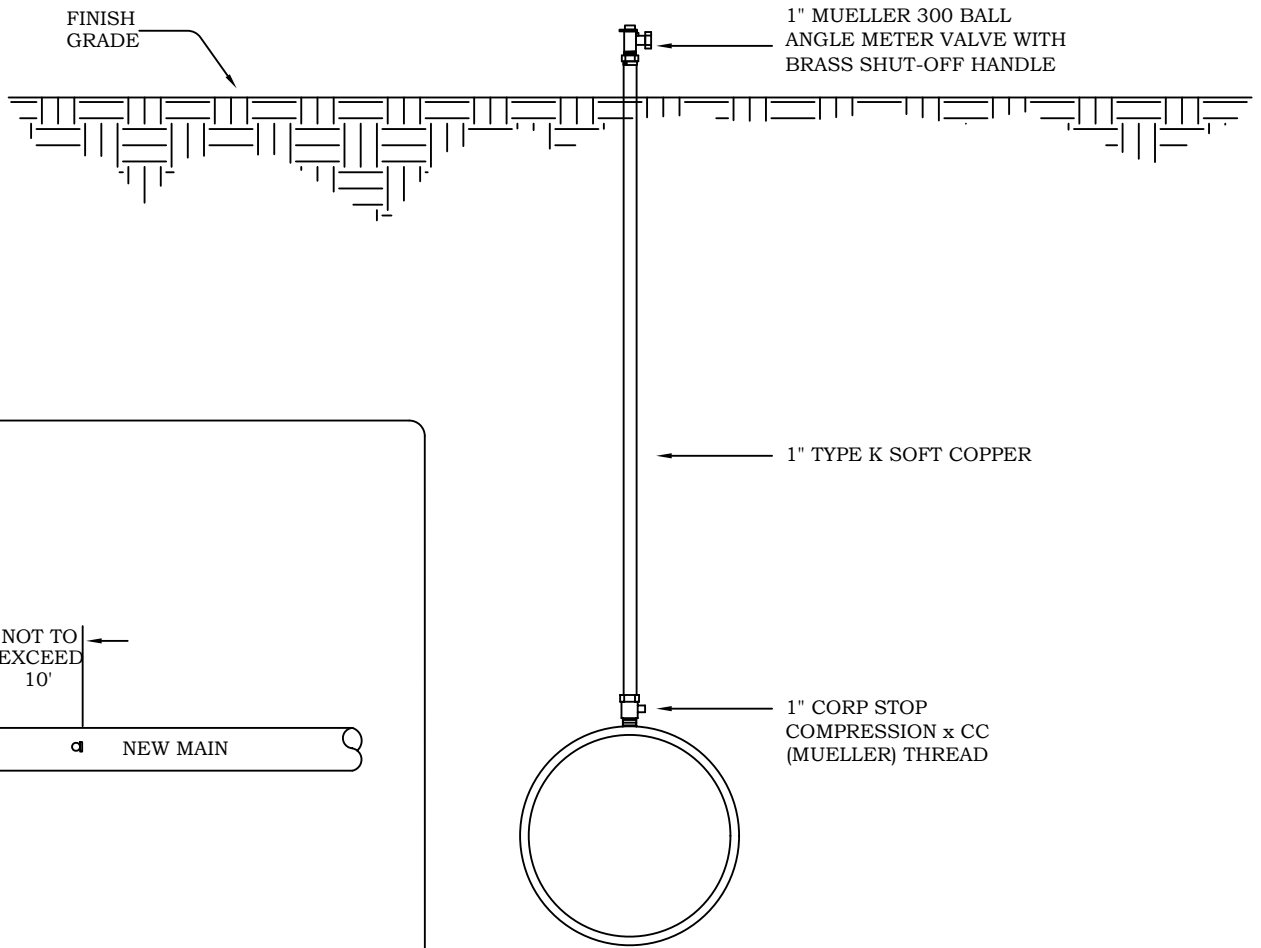

NOT TO SCALE



# CHLORINATION TAP

DATE	REVISION

DATE	12/11/14		
DRAWN	SLW	APPROVED	WSC
		SPEC NO.	CT